


1250 Gallon Top Seam - 2CP

Item #
1250T-2CP

Top View

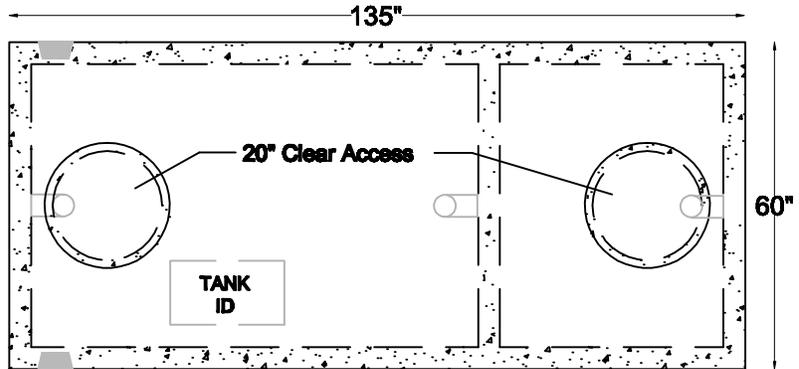


DESIGN NOTES

- Design per performance test per ASTM C1227
- Top surface area 56.25 ft²
- f'c @ 28 days; concrete = 6,000 PSI Min.

Installation:

- Tank to be set on 5" min. sand bed or pea gravel
- Tank to be backfilled uniformly on all sides in lifts less than 24" and mechanically compacted
- Excavated material may be used for backfill, provided large stones are removed
- Excavation should be dewatered and tank filled with water prior to being put in service for installation with water table less than 2' below grade
- Meets C1644-06 for resilient connectors
- Inlet and Outlet identified above pipe
- Delivered complete with internal piping

Risers to Grade

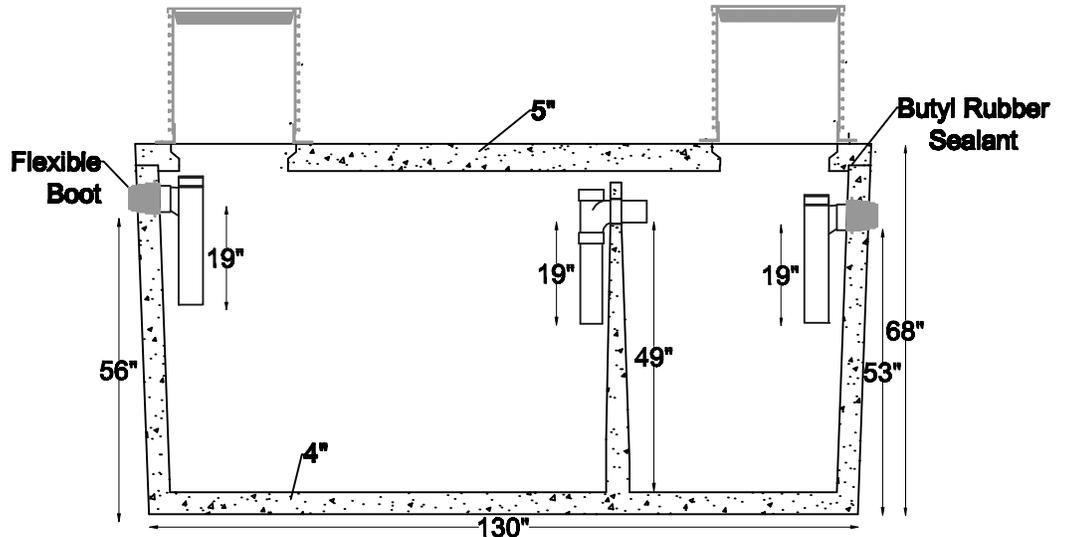

Section View

ALLOWABLE BURY (Based on Water Table)	
WATER TABLE	ALLOWABLE EARTH FILL
0' - 0"	2' - 0"
1' - 0"	3' - 0"
2' - 0"	3' - 0"
3' - 0"	4' - 0"
DRY	4' - 0"

Digging Specs	Invert		Dimensions			Net Capacity			Net Weight		
	Inlet	Outlet	Length	Width	Height	Inlet Side	Outlet	Total	Lid	Tank	Total
13' Long x 7' Wide	Inlet	Outlet	135"	60"	68"	843 gal	416 gal	1259 gal	3120 lbs	10880 lbs	14000 lbs
56" below inlet	56"	53"									

VALLEY PRECAST, Inc.
Buena Vista, Colorado

Phone: 719-395-6764
Fax: 719-395-3727
Website: www.valleyprecast.com
Email: frontdesk@valleyprecast.com