


1500 Gallon Top Seam Potable Water Cistern

Item #
1500T-CIS

Top View

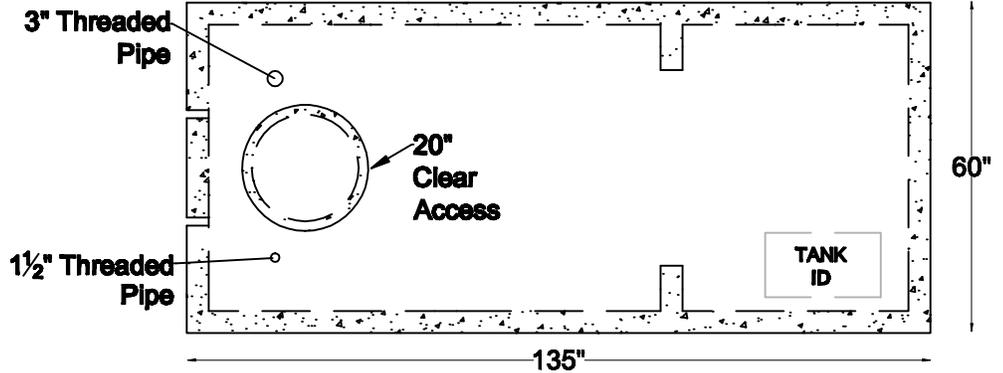


DESIGN NOTES

- Meets or exceeds ASTM C-913 spec for water structure
- Top surface area 56.25 ft²
- f'c @ 28 days; concrete = 6,000 PSI Min.

Installation:

- Tank to be set on 5" min. sand bed or pea gravel
- Tank to be backfilled uniformly on all sides in lifts less than 24" and mechanically compacted
- Excavated material may be used for backfill, provided large stones are removed
- Excavation should be dewatered and tank filled with water prior to being put in service for installation with water table less than 2' below grade
- Durable stainless steel NPT threaded 3" fill line and 1 1/2" universal on top
- Two 1 1/4" brass NPT universal low entries
- Lightweight sealed lid
- Secondary safety screen available with PVC riser
- 4' Maximum bury depth

Section View

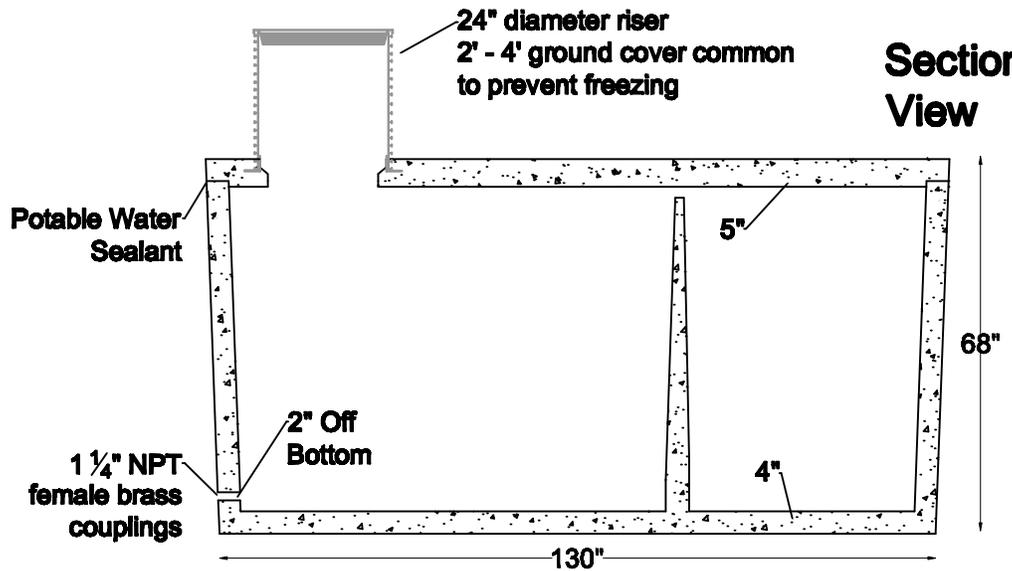

ALLOWABLE BURY (Based on Water Table)	
WATER TABLE	ALLOWABLE EARTH FILL
0' - 0"	2' - 0"
1' - 0"	3' - 0"
2' - 0"	3' - 0"
3' - 0"	4' - 0"
DRY	4' - 0"

Digging Specs	Dimensions			Net Capacity	Net Weight		
	Length	Width	Height		Lid	Tank	Total
13' Long x 7' Wide 2' to 4' Cover Standard	135"	60"	68"	1578 gal	3120 lbs	10110 lbs	13230 lbs

VALLEY PRECAST, Inc.
Buena Vista, Colorado

Phone: 719-395-6764
Fax: 719-395-3727
Website: www.valleyprecast.com
Email: frontdesk@valleyprecast.com