

2000 Gallon Top Seam - 2CP for MicroFast .625 Unit


Item #
2000T-2CP-Fast.625

DESIGN NOTES

- Design per performance test per ASTM C1227
- Top surface area 87.75 ft²
- f'c @ 28 days; concrete = 6,000 PSI Min.


Installation:

- Tank to be set on 5" min. sand bed or pea gravel
- Tank to be backfilled uniformly on all sides in lifts less than 24" and mechanically compacted
- Excavated material may be used for backfill, provided large stones are removed
- Excavation should be dewatered and tank filled with water prior to being put in service for installation with water table less than 2' below grade
- Meets C1644-06 for resilient connectors
- Inlet and Outlet identified above pipe
- Delivered complete with internal piping
- Complete system installation available in some areas
- 4' Maximum bury depth

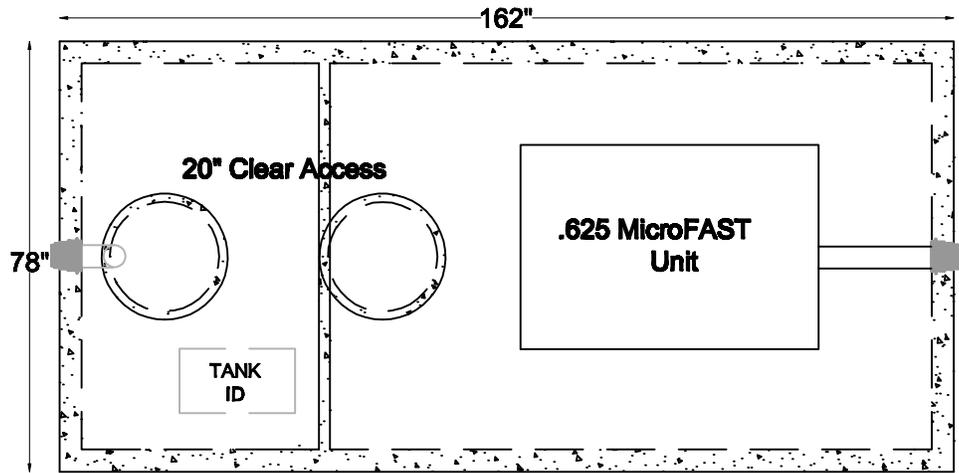

Top View

ALLOWABLE BURY (Based on Water Table)	
WATER TABLE	ALLOWABLE EARTH FILL
0' - 0"	3' - 0"
1' - 0"	3' - 0"
2' - 0"	4' - 0"
3' - 0"	4' - 0"
DRY	4' - 0"

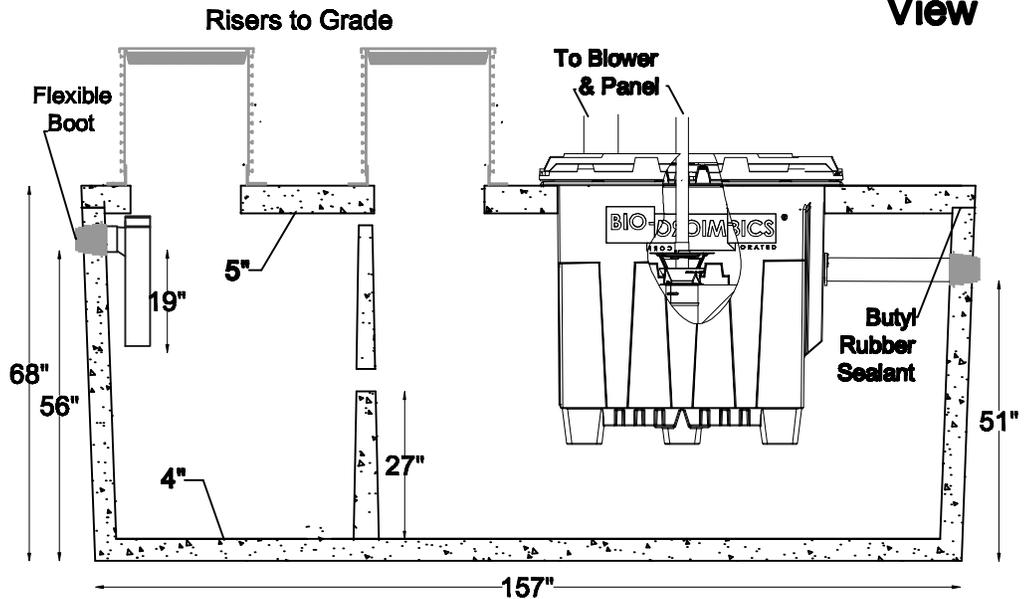

Section View



Digging Specs	Invert		Dimensions			Net Capacity			Net Weight		
	Inlet	Outlet	Length	Width	Height	Inlet Side	Outlet	Total	Lid	Tank	Total
15' Long x 8' Wide	56"	51"	162"	78"	92"	604 gal	1460 gal	2064 gal	4340 lbs	15530 lbs	19870 lbs



Phone: 719-395-6764
 Fax: 719-395-3727
 Website: www.valleyprecast.com
 Email: frontdesk@valleyprecast.com