

1000 Gallon Top Seam - 2CP with High Head Pump



Item #
1000T-2CP-HH

DESIGN NOTES

- Design per performance test per ASTM C1227
- Top surface area 46.25 ft²
- f'c @ 28 days; concrete = 6,000 PSI Min.

Installation:

- Tank to be set on 5" min. sand bed or pea gravel
- Tank to be backfilled uniformly on all sides in lifts less than 24" and mechanically compacted
- Excavated material may be used for backfill, provided large stones are removed
- Excavation should be dewatered and tank filled with water prior to being put in service for installation with water table less than 2' below grade
- Meets C1644-06 for resilient connectors
- Inlet and Outlet identified above pipe
- Delivered complete with internal piping
- Control Panel to be mounted in sight line of tank
- 4' Maximum bury depth

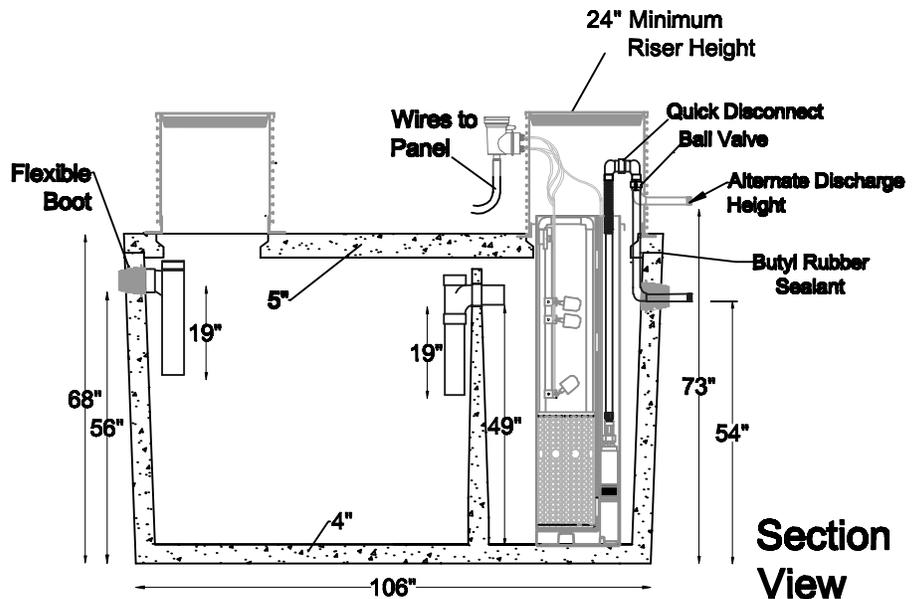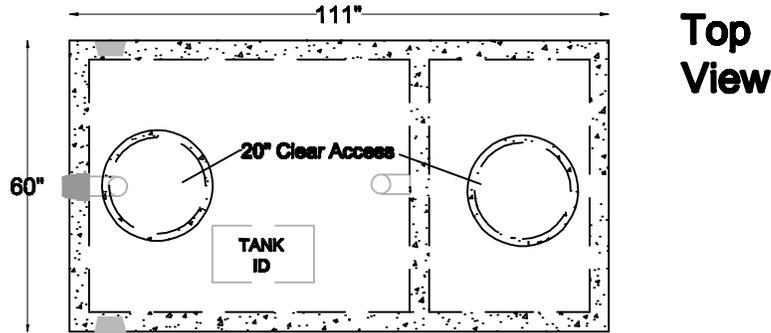

ALLOWABLE BURY (Based on Water Table)	
WATER TABLE	ALLOWABLE EARTH FILL
0' - 0"	2' - 0"
1' - 0"	3' - 0"
2' - 0"	3' - 0"
3' - 0"	4' - 0"
DRY	4' - 0"

Service contracts available for maintenance

Pump:

- Lowers TSS and improves effluent quality to field
- Complete installation (wiring, panel, mounting and start-up procedures)
- Complete warranty

Digging Specs	Invert		Dimensions			Net Capacity			Net Weight		
	Inlet	Outlet	Length	Width	Min. Height	Inlet Side	Outlet	Total	Lid	Tank	Total
11' Long x 7' Wide											
56" below inlet	56"	54" or 73"	111"	60"	92"	687 gal	323 gal	1010 gal	2620 lbs	9380 lbs	12200 lbs



Phone: 719-395-6764
Fax: 719-395-3727
Website: www.valleyprecast.com
Email: frontdesk@valleyprecast.com